

Eemax Electric Tankless Water Heater - Customer Sign-off

To confirm configuration for XTP products for commercial and industrial applications.

If you need assistance please contact Eemax Inc @ 1-800-543-6163

FEBRUARY 28, 2019

ALL HIGHLIGHTED AREAS MUST BE FILLED OUT FOR ORDER TO BE COMPLETE

Purchase Order Date: _____ Customer P. O. Number: _____

Project Name and Location: _____

Contractor Name and phone #: _____

Model requested _____ Total # of heaters ordered _____

Available Voltage

208V Three Phase Delta

480V Three Phase Delta

Kilowatt (kW) Output- 480 VOLT

16KW

20KW

24KW

27KW

36KW

48KW

54KW

Kilowatt (kW) Output- 208 VOLT

18KW

24KW

32KW

NEMA CABINETS ARE AVAILABLE AT ADDITIONAL COST

STANDARD-NON- WATERPROOF SHEET METAL COVER

**NEMA
OR Cabinet
Selection**

N4 NEMA 4
(powder coatgray)

N4X NEMA 4
(304 SS)

N4X6 NEMA 4
(316 SS)

(water heater must be installed in a NEMA cabinet (above) to support options below)

FP-FREEZE PROTECTION

EDS- NON – FUSED ELECTRICAL DISCONNECT

FDS- FUSED ELECTRICAL DISCONNECT

EP- EXPLOSION PROOF C1D2- PURGE/ PRESSURIZE CONTROL


GFCI-GROUND FAULT CIRCUIT INTERRUPTER

SK- STAND KIT / FREE STANDING

SB- SIREN / BEACON


ES- EMERGENCY STOP SWITCH

Is heater part of a recirculation loop? Yes No
 Please indicate how heater is to be used in the recirculation loop

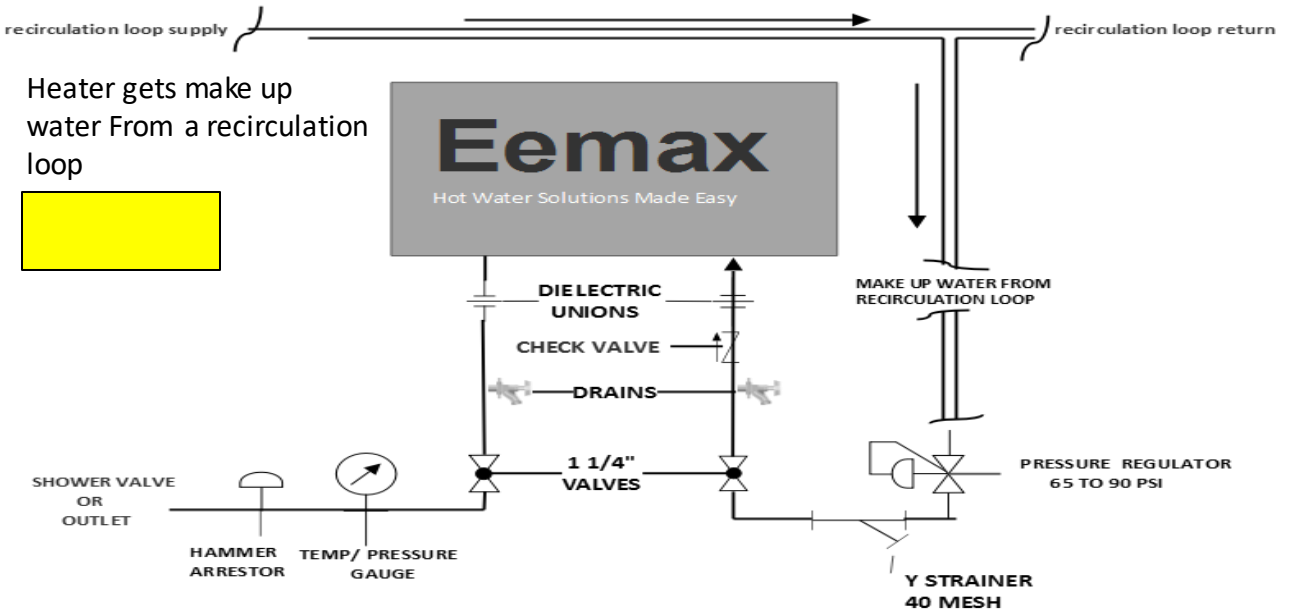

HEATER MUST NOT BE PIPED IN THIS CONFIGURATION

Heater in direct line With recirculation loop

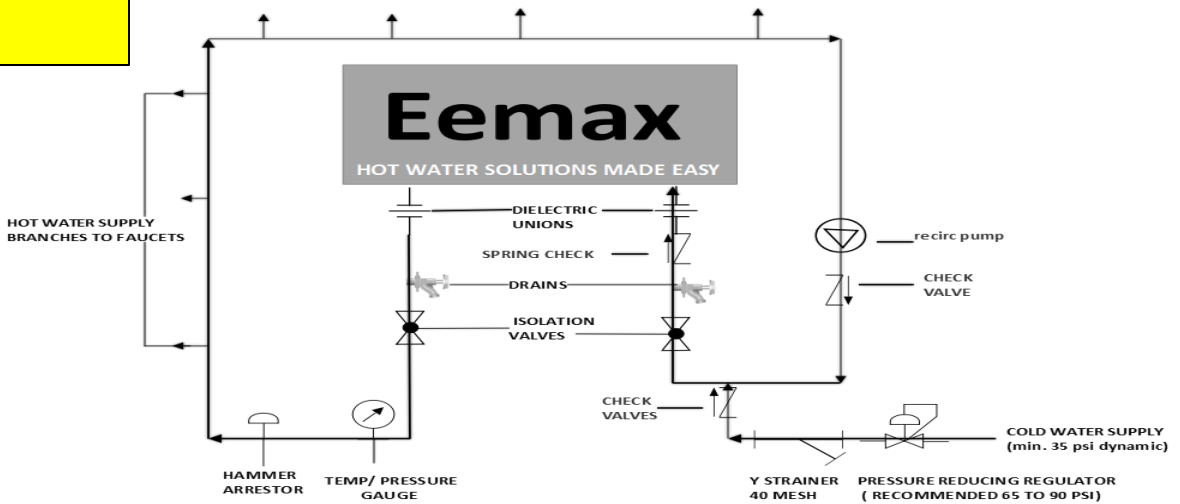

Signature: _____

PROVIDE BRIEF DESCRIPTION OF HEATER APPLICATION:

These units are custom made. Upon return of this form, order is NON-CANCELABLE and the items are NON-RETURNABLE. Orders will be released to production when sign off is returned.

Please sign below as acceptance of these terms, conditions and installation requirements.

Return via fax to (203)267-7975 or email to info@eemaxinc.com to authorize production.

Print Name: _____

Signature: _____

Title & Company: _____ Date: _____